


SMOKE EXTRACTION DUCT self-supporting EI 90-S

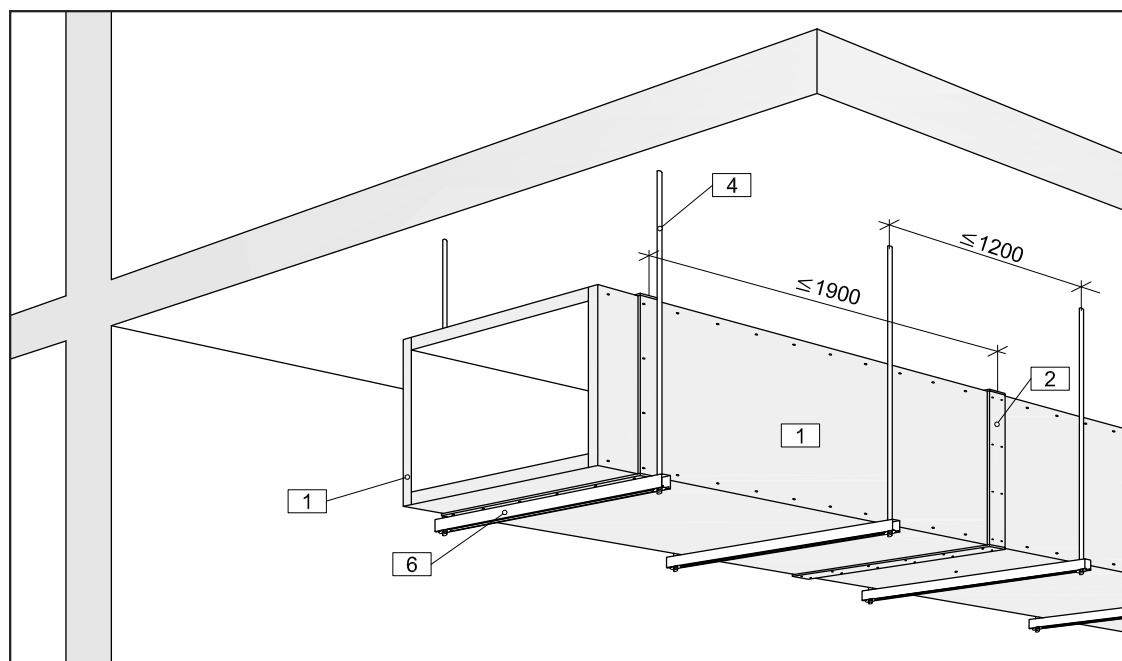

DESIGN DESCRIPTION

Single layer, 4-sided smoke extraction duct with a fire resistance of 90 min.

Made by butt jointing of fire protection boards **THERMAX SL**, th = 45 mm, the joints are glued and screwed or stapled.

The board joints of the duct segments are covered with **THERMAX A** cover strips. The cover strips are glued and screwed or stapled.

Horizontal smoke extraction ducts are supported on traverses, which are suspended by threaded rods (tensile stress $\leq 6 \text{ N/mm}^2$ and shearing stress $\leq 10 \text{ N/mm}^2$). The attachment to solid floors are done with approved dowels with fire protection technical suitability certificate. Each duct segment ($L \leq 1900 \text{ mm}$) shall be provided with min. one suspension (distance $\leq 1200 \text{ mm}$).

Threaded rods with a length over 1,50 m have to be protected using **THERMAX SL**.

At the penetration of solid building constructions $\geq 150 \text{ mm}$ with at least the same fire resistance as the smoke extraction duct, the remaining opening of $10 \leq E \leq 30 \text{ mm}$ has to be sealed with mineral wool (non combustible, melting point $\geq 1000^\circ\text{C}$) and covered on both sides with an L-shaped angle made of two composite **THERMAX SL** board strips. The L-angles are attached to the walls with metal dowels.

Vertical smoke extraction ducts are settled at each storey max. every 5 m on solid floors.

MATERIAL:

- Fire protection boards **THERMAX SL**
th = 45 mm
- Cover strip **THERMAX A**
th $\geq 10 \text{ mm}$, w $\geq 100 \text{ mm}$
- Fire protection glue **THERMAX Brand-schutzkleber**


GENERAL INFORMATION:

- Classification: EI 90 (ve - ho) S 500 multi
- 4-sided smoke extraction ducts, self-supporting, made of **THERMAX SL** fire protection boards
- max. internal duct section:
 $\leq 1250 \times 1000 \text{ (W x H)}$
- Operating pressure: $\pm 500 \text{ Pa}$


Further possible duct sections

- EI 90 (ve) S 500 multi $\leq 1500 \times 800 \text{ mm}$ (WxH) internal section, with one stiffener as well as
- EI 90 (ho) -S $\leq 1800 \times 1000 \text{ mm}$ (WxH) internal section, with one stiffener
- Operating pressure: $\pm 500 \text{ Pa}$


DESIGN DETAILS

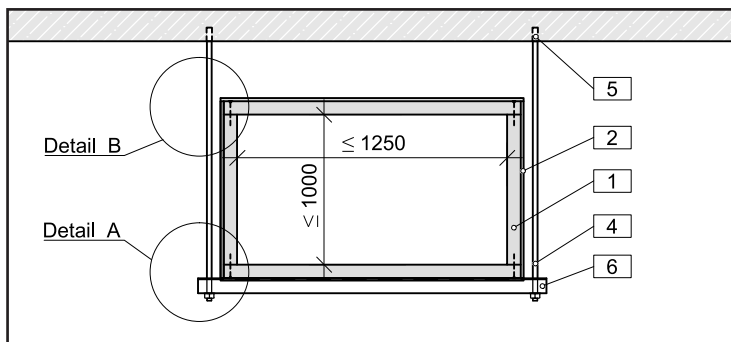


[1] Cross-section horizontal smoke extraction duct

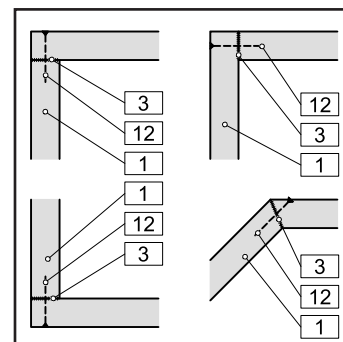


[2] Corner connection

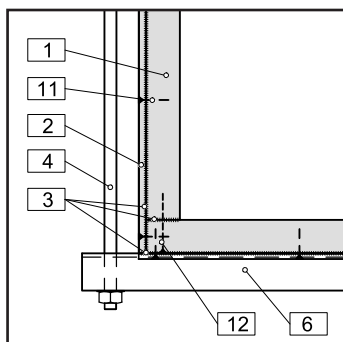


[3] Detail A: Corner design bottom

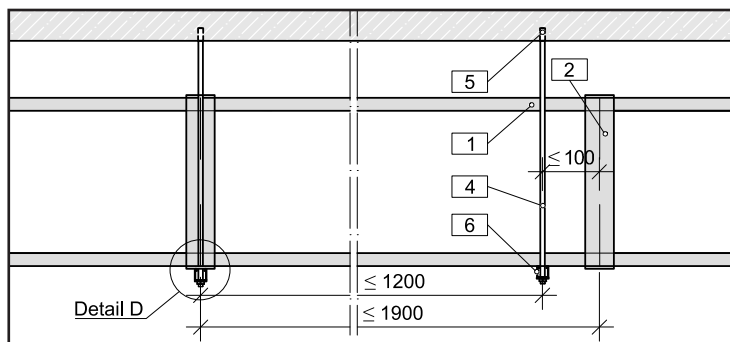


[4] Longitudinal section horizontal smoke extraction duct

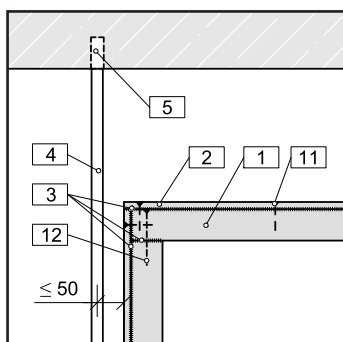


[5] Detail B: Corner design above

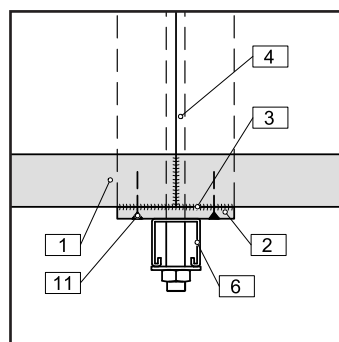


[6] Detail D: Suspension at butt joint

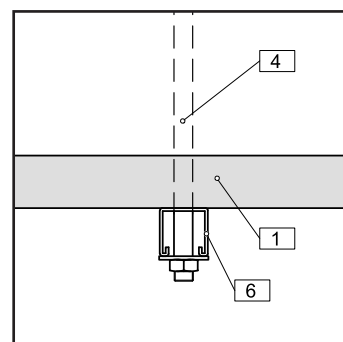

[7] Detail D: Suspension Var. 1

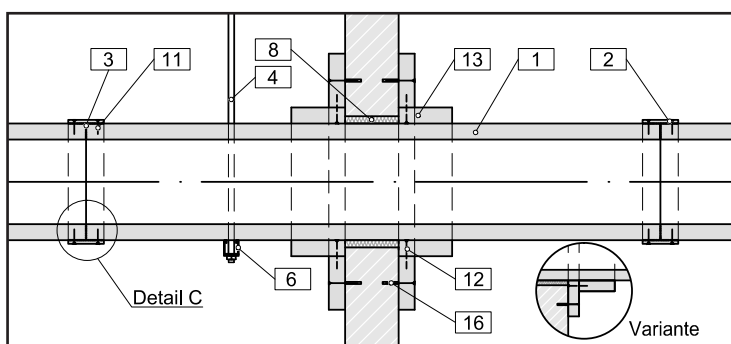

[8] Wall penetration

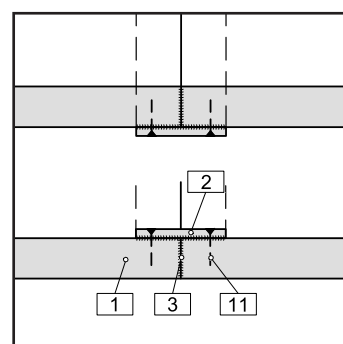

[9] Detail C: Cover strip horizontal, inside and outside

MINERALKA d.o.o.


THERMAX-Fire Protection Products
Sales and Engineering

T +43.7472.685 66 0
F +43.7472.685 66 20


visit us
www.thermax.at

The content of this catalogue and information about it has been provided in good faith, under the exclusion of liability and makes no claim to completeness. The content is provided as assistance to the Mineralka product users and resellers, who are fully responsible for their actions. Stipulations in the official document only are legally binding for the user.


DESIGN DETAILS

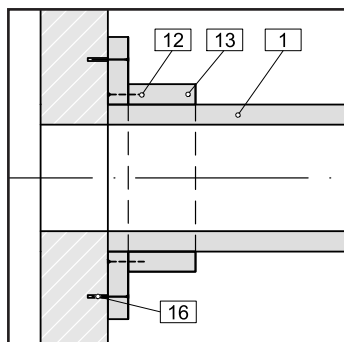


[10] Detail: Wall connection

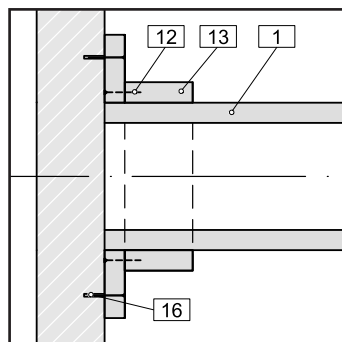


[11] Wall connection, Var. 1

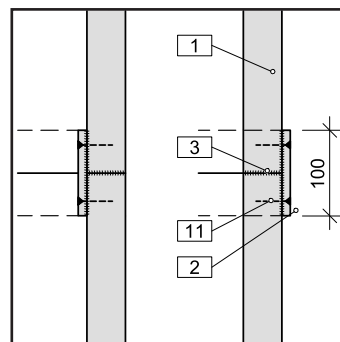


[12] Cover strip vertical, inside and outside

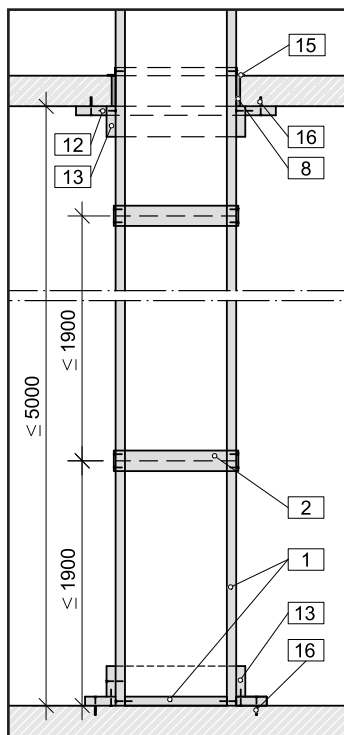


[13] Vertical smoke extraction duct

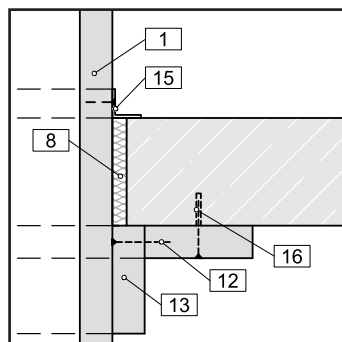


[14] Detail: Ceiling penetration

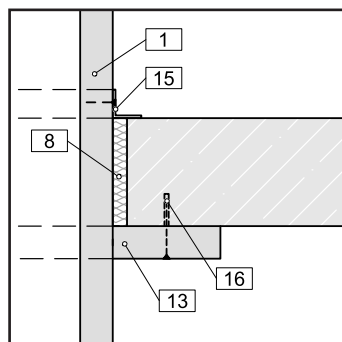


[15] Detail: Ceiling penetration, Var. 1

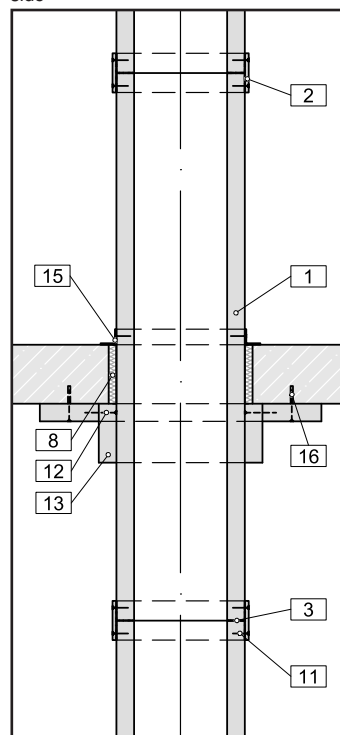


[16] Ceiling penetration

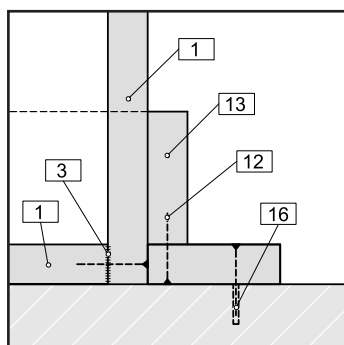

[17] Detail: Floor connection

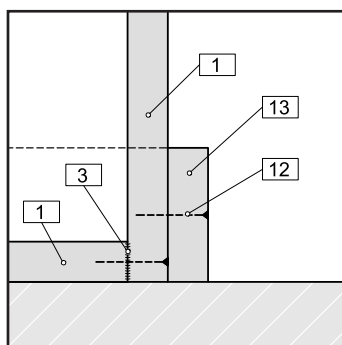

[18] Detail: Floor connection, Var. 1

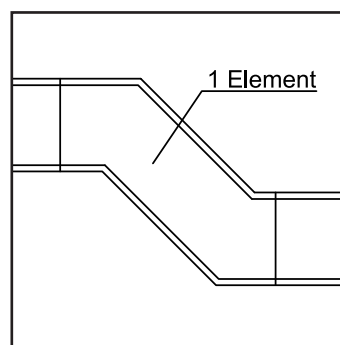

[19] Principal design

MINERALKA d.o.o.


THERMAX-Fire Protection Products
Sales and Engineering

T +43.7472.685 66 0
F +43.7472.685 66 20


visit us
www.thermax.at

The content of this catalogue and information about it has been provided in good faith, under the exclusion of liability and makes no claim to completeness. The content is provided as assistance to the Mineralka product users and resellers, who are fully responsible for their actions. Stipulations in the official document only are legally binding for the user.


DESIGN DETAILS

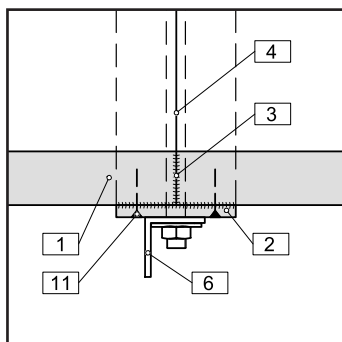


[20] Detail D: Suspension at butt joint

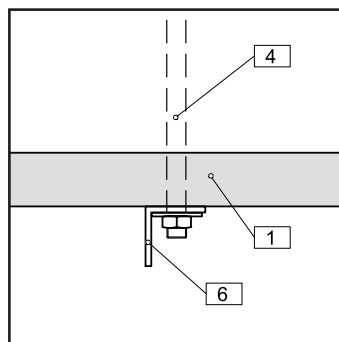

[21] Detail D: Suspension, Var. 1

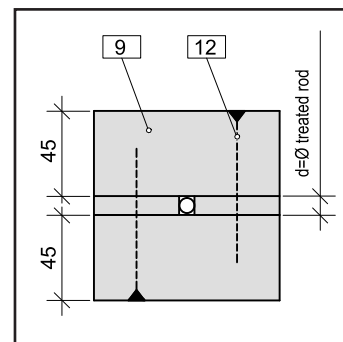

[22] Threaded rod protection

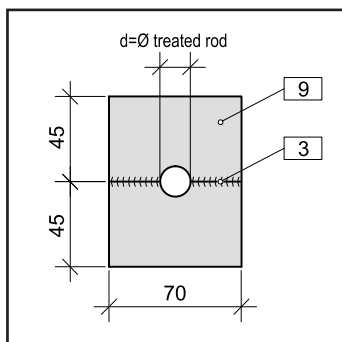

[23] Threaded rod protection, Var. 1

MATERIAL LIST

- | | |
|---|---|
| <p>1 THERMAX SL
fire protection board th = 45 mm</p> <p>2 Cover strip
THERMAX A
th ≥ 10 mm, w ≥ 100 mm
glued and screwed or stapled</p> <p>3 THERMAX Brandschutzkleber
fire protection glue</p> <p>4 Threaded rod ≥ M8 with
nut and washer tensile
stress ≤ 6 N/mm² and
shearing stress ≤ 10 N/mm²
acc. to static calculation</p> <p>5 Metal dowel/steel expansion
dowel ≥ 8 mm (with fire protection
technical suitability approval)
acc. to static calculation</p> <p>6 Mounting rails/traverse as
suspension device,
distance ≤ 1200 mm, e.g.
Würth Varifix C ≥ 41/41/2,5 mm or
Hilti ≥ MQ41 or
statically equivalent</p> <p>8 Mineral wool A1,
melting point ≥ 1000°C,
density ≥ 50 kg/m³,
gap 10 mm ≤ E ≤ 30 mm</p> | <p>9 THERMAX SL
threaded rod protection at
height of hangers > 1500 mm</p> <p>11 Steel wire staples or drywall-/
chipboardscrews for cover
strips 38/10/1 mm,
distance ≤ 100 mm or
4 x 40 mm, distance ≤ 200 mm</p> <p>12 Steel wire staples or drywall-/
chipboardscrews
80/11,2/1,2 mm,
distance ≤ 100 mm or
5 x 80 mm, distance ≤ 200 mm</p> <p>13 THERMAX SL
board strips th = 45 mm,
w ≥ 100 mm</p> <p>15 Steel angle ≥ 40 x 40 x 4 mm
at ceiling penetration with
drywall screws 4 x 40 mm
(distance ≤ 100 mm)</p> <p>16 Steel expansion dowel ≥ M6,
distance ≤ 250 mm
(with fire protection technical
suitability approval)</p> |
|---|---|